


INLINE FLOW METER

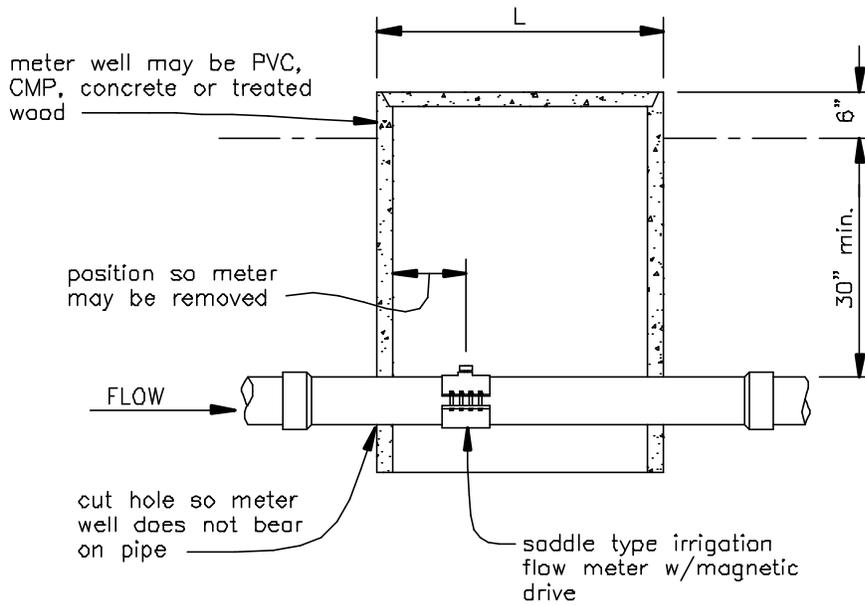

INLINE METER

METER WELL DIMENSIONS

W = _____ ft

L = _____ ft


D = _____ ft

Dia. = _____ ft

INLINE FLOW METER

Dia. = _____ in

Capacity _____ gpm

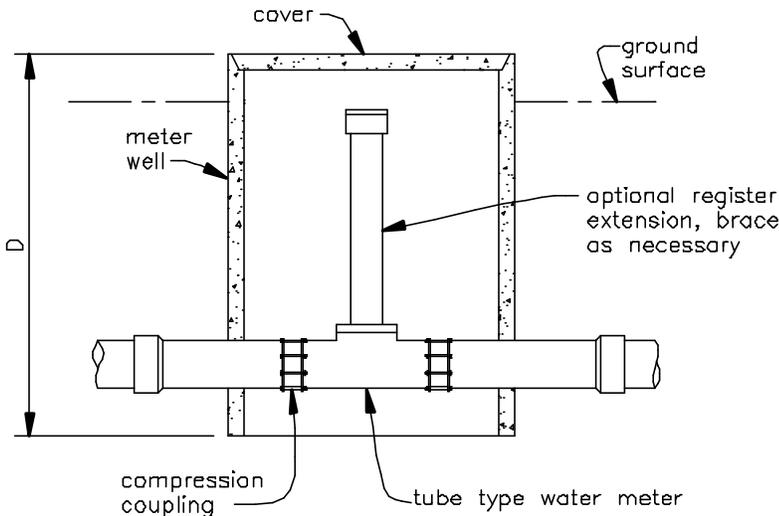

NOTES

This project shall be constructed using NRCS construction specifications 430 DD, High-Pressure Underground Plastic Pipeline; 430 FF, Steel Pipelines; and 587, Structure for Water Control. The specification is attached to this drawing and shall be part of this plan.

This standard drawing requires supporting technical documentation prior to use and must be adapted to the specific site.

ALTERNATE "A"
METER WITH METER EXTENSION
AND/OR COMPRESSION COUPLINGS

Drawing not to scale.

U.S.D.A. NATURAL RESOURCES CONSERVATION SERVICE	JOB CLASS _____	Date _____
	CAD FILE NO. IWM-0020.DWG	Designed _____
	SHEET _____ OF _____	Drawn _____
		Checked _____
	Approved _____	