


FROST FREE FLOAT VALVE

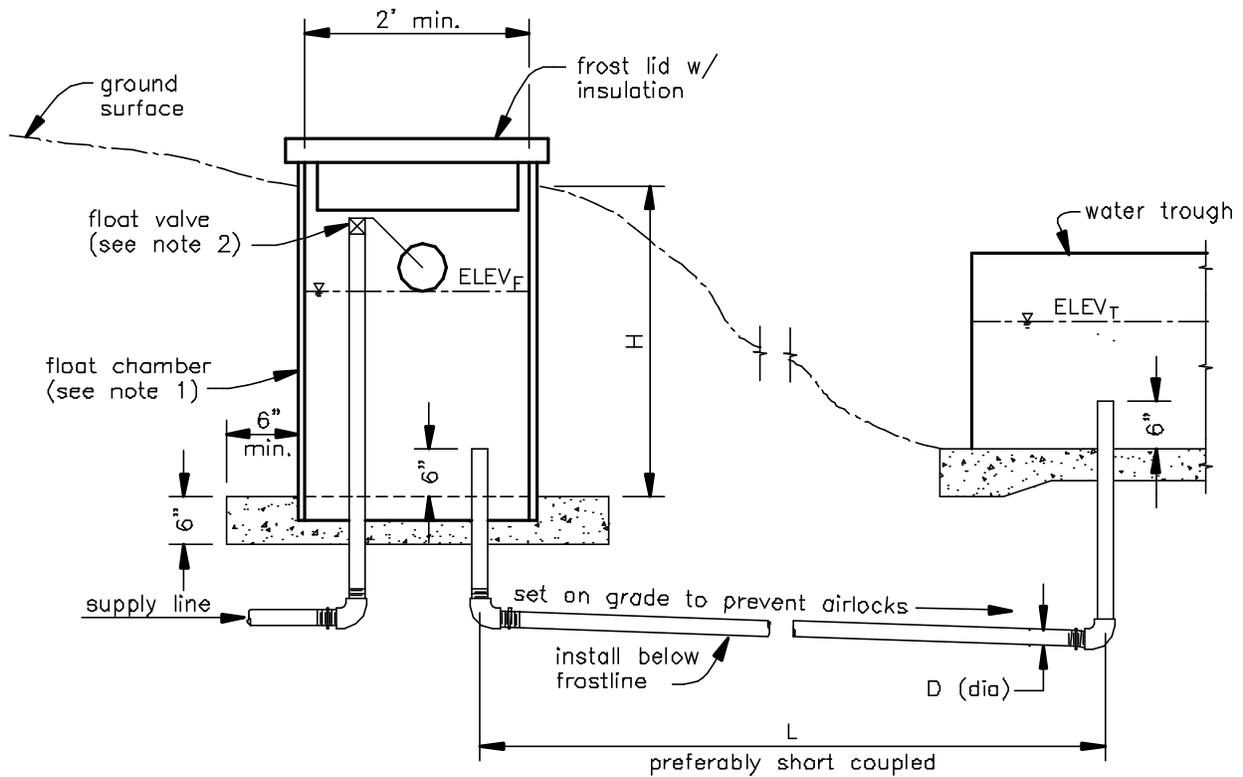

NOTE 1: The float chamber shall be constructed of reinforced concrete pipe, welded steel pipe, corrugated steel pipe, cast-in-place concrete or other suitable material. It shall be sized to provide ready access for repair and/or replacement of plumbing fixtures.

NOTE 2: Discharge outlet of float valve shall be placed 2 times the diameter of the inlet conduit above rim of tank.

DIMENSIONS

D (dia) = _____ in

L = _____ ft

H = _____ ft

ELEV_F = _____ ft

ELEV_T = _____ ft

Drawing not to scale. Standardized drawings must be adapted to the specific site.

U.S.D.A. NATURAL RESOURCES CONSERVATION SERVICE	JOB CLASS _____	Date _____
	CAD FILE NO. LSK-0151.DWG	Designed _____
	SHEET _____ OF _____	Drawn _____
		Checked _____
	Approved _____	