





1600-3000 GAL TANK SLAB ANCHOR DETAIL

Drawing not to scale

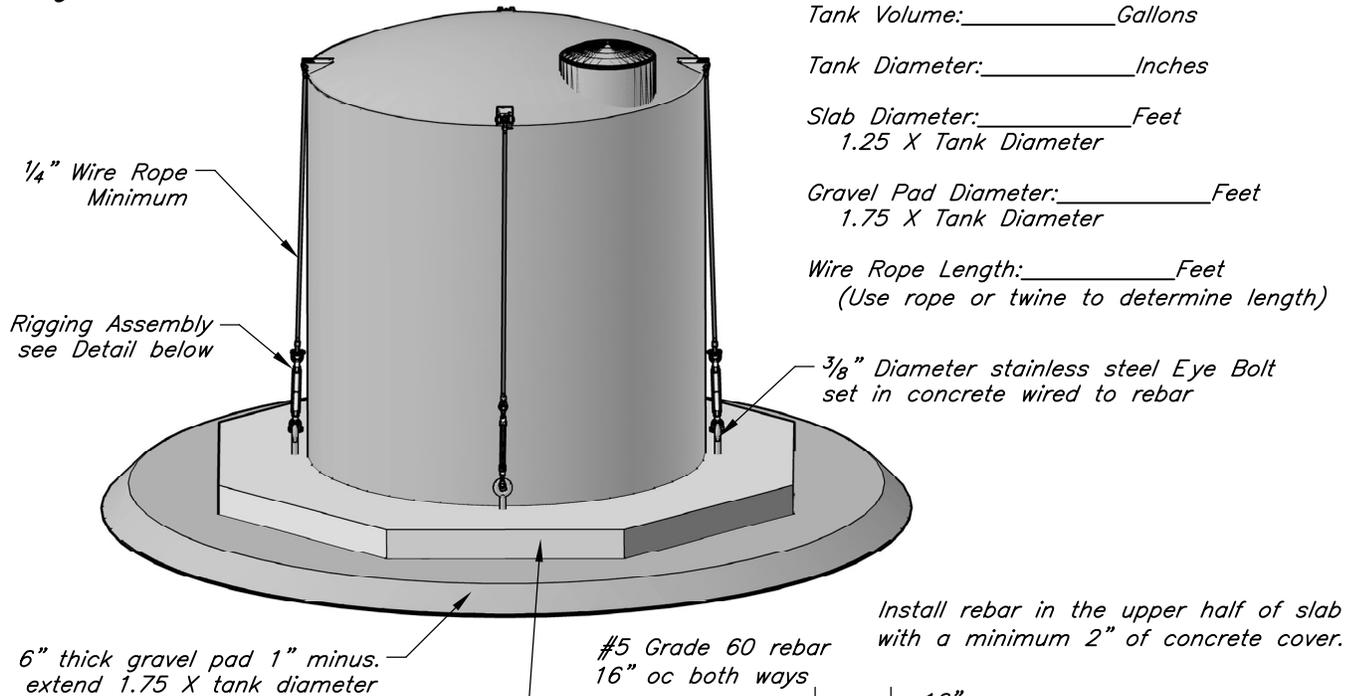

Install rebar in the upper half of slab with a minimum 2" of concrete cover.
 #5 Grade 60 rebar
 16" oc both ways

7" thick reinforced 4000 psi concrete slab
 see CS-42 Concrete for Minor Structures
 and MS-203 Concrete

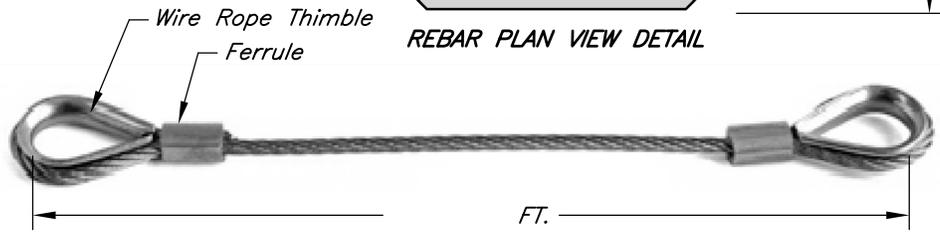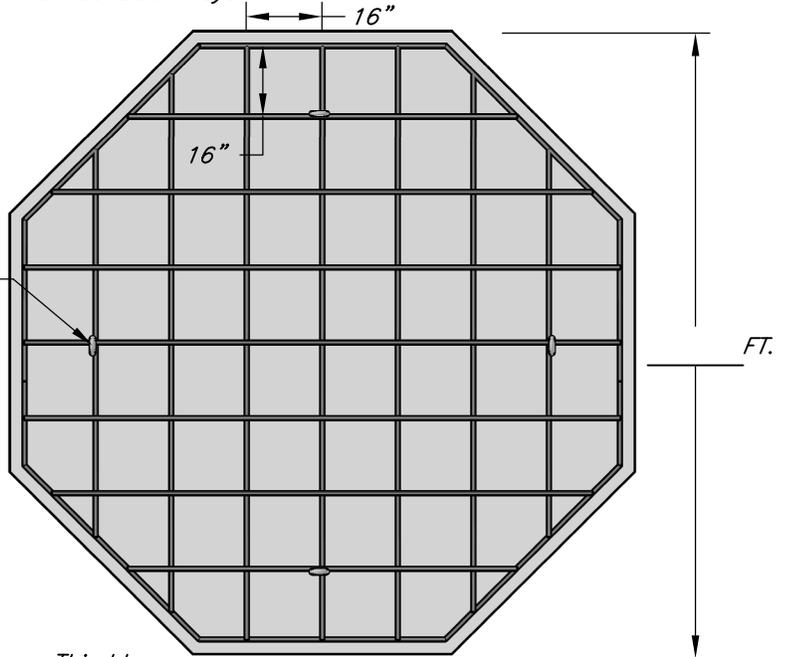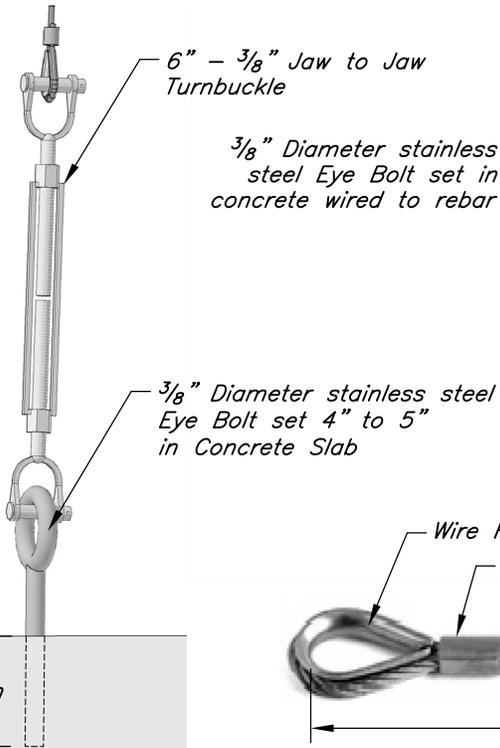

RIGGING ASSEMBLY

1/4" WIRE ROPE SLING WITH HARD THIMBLE EYES

JOB CLASS	Date
CAD FILE NO. LSK-0173.dwg	Designed _____
SHEET OF	Drawn _____
	Checked _____
	Approved _____