



Typical foundation treatment is a layer of compacted base course (crushed rock 100% less than 3"), gravel or other approved aggregate, placed in 6" loose lifts and compacted with at least 3 passes of a vibratory plate compactor. See note below

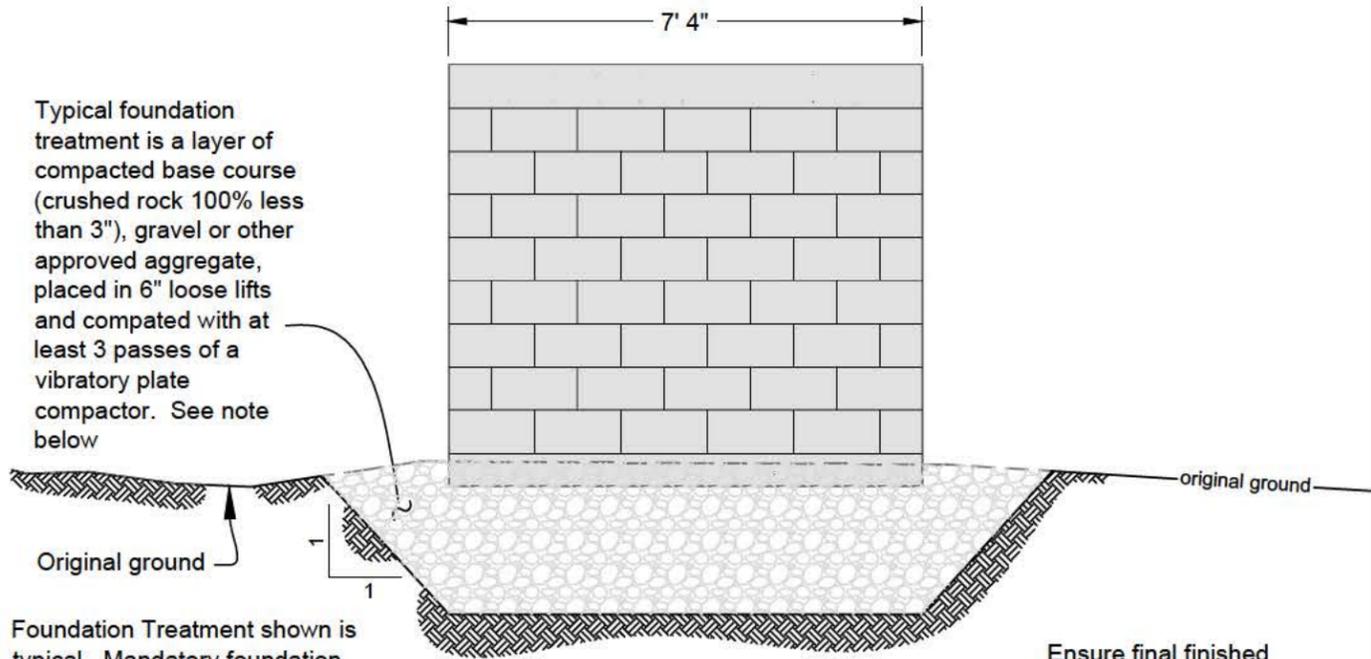

Foundation Treatment shown is typical. Mandatory foundation inspection and approval by NRCS technical representative is required before placement of base course. The final thickness of material under the tank will be reflected in the "As Built" drawings.

### Excavation & Foundation


Ensure final finished surface slopes away from the tank, i.e. avoid having surface water pond near or enter the tank.

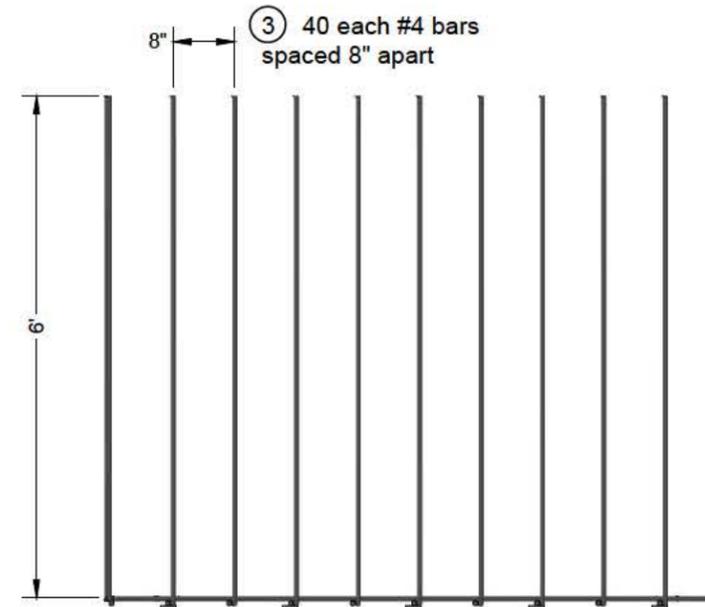

### Vertical Steel Placement


no scale

2" x 2" x 3" concrete "chairs" to support steel during pouring of concrete. Place chairs on 16" centers. Other spacers manufactured for this purpose may be used in lieu of concrete with the approval of the NRCS Technical Representative

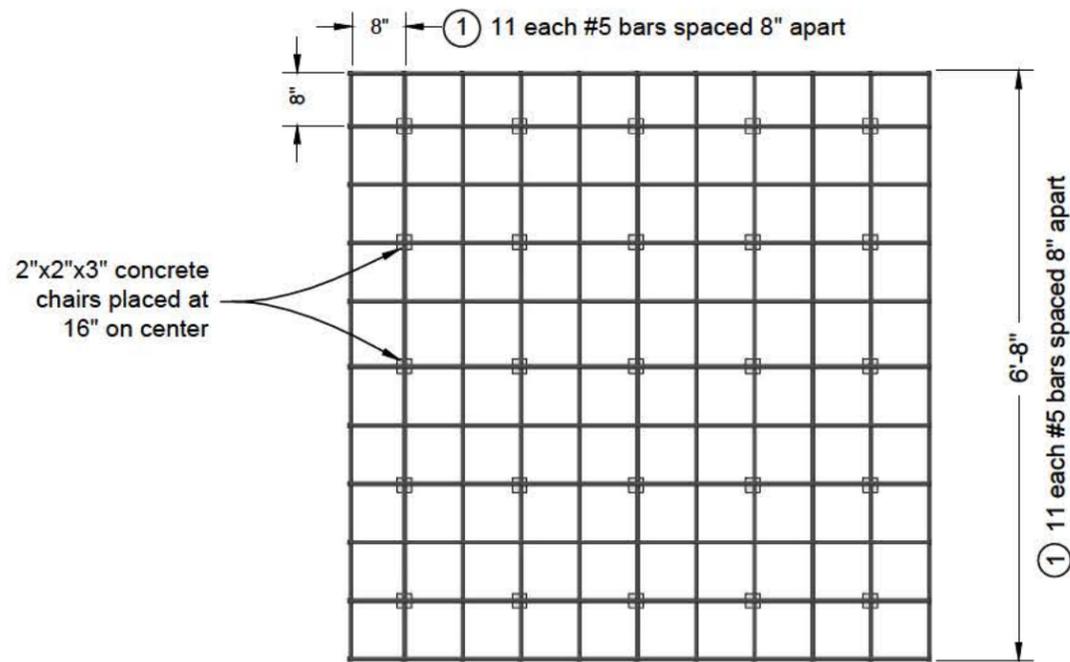

### Floor Pad Steel Placement

no scale

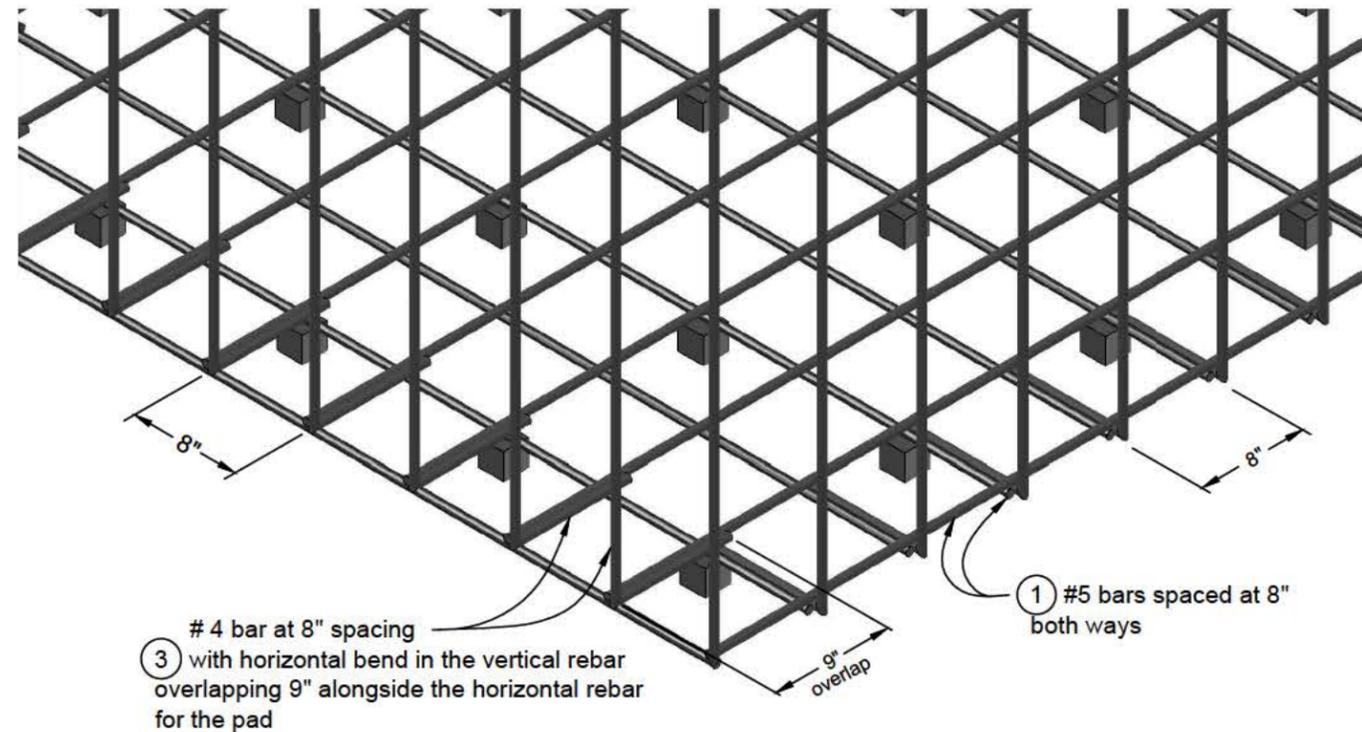

### Pad and Vertical Steel Placement

no scale

Date \_\_\_\_\_  
 Designed \_\_\_\_\_  
 Drawn \_\_\_\_\_  
 Checked \_\_\_\_\_  
 Approved \_\_\_\_\_  
 Title \_\_\_\_\_

6' x 6' x 6' Concrete Block Tank (no roof)  
 Cooperating with the \_\_\_\_\_ Soil and Water Conservation District



File Name \_\_\_\_\_ .dwg  
 Drawing No. \_\_\_\_\_  
 Sheet \_\_\_\_\_ of \_\_\_\_\_